


NOTES:

1. THIS CONCEPTUAL DETAIL IS A GUIDE FOR INSTALLATION OF NICHIIHA PRODUCTS. ARCHITECTS/ENGINEERS/CONTRACTORS ARE RESPONSIBLE FOR SUCCESSFUL APPLICATION WHICH DEPENDS UPON SUBSTRATE DESIGN AND CONSTRUCTION BUILT IN ACCORDANCE WITH BEST PRACTICES AND LOCAL BUILDING CODES.
2. ONLY NICHIIHA AWP-3030 MAY BE USED FOR VERTICAL APPLICATIONS.
3. SHEATHING: FOR VERTICAL AWP-3030, 7/16" OR THICKER APA RATED OSB OR PLYWOOD REQUIRED WITH STUD SPACING OTHER THAN 45.5 CM (17-7/8") O.C.
4. METAL FRAMING MEMBERS MUST BE A MINIMUM OF 18 GA.

TRANSITION
DETAIL

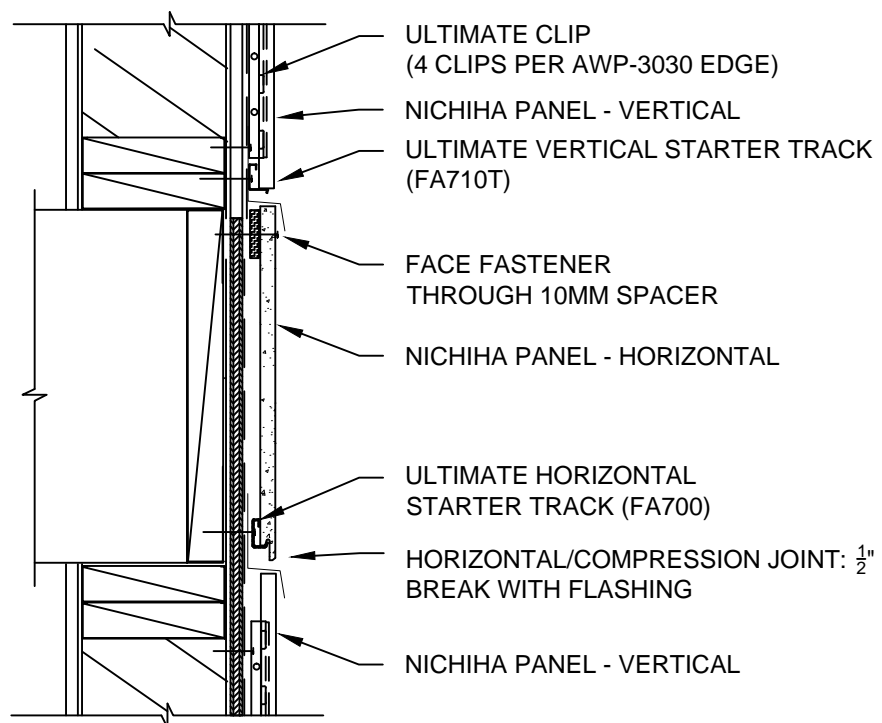

AWP-3030 VERTICAL WITH HORIZONTAL AWP BAND -
HORIZONTAL TRANSITION JOINTS

SCALE: $1\frac{1}{2}$ " = 1'-0"